

\* approximate size in inches, image not to scale

• Ambient Temp Range

- Water Temp Range
- Water Pressure
- Voltage Range

## Service

- Panels easily removed and all components accessible for service.
- Allow 6" (15 cm) clearance at rear and sides for proper air circulation and ease of maintenance/service. Allow 24" (61 cm) clearance at top for removal of auger.

45 - 100°F

10 - 113 PSIG

45 - 90°F

187-253V

## Plumbing


- Icemaker Water Supply Line: Minimum 1/4" Nominal ID Copper Water Tubing or Equivalent
- Icemaker Drain Line: Minimum 3/4" Nominal ID Hard Pipe or Equivalent

Water-Cooled Model (Lines Must Be Independent of Icemaker)

- Condenser Water Supply Line: Minimum 1/4" Nominal ID Copper Water Tubing or Equivalent
- Condenser Drain/Return Line: Minimum 1/4" Nominal ID Hard Pipe (open drain system) or Copper Water Tubing
- (closed loop system) or Equivalent

Printed in the U.S.A

Hoshizaki reserves the right to change specifications without notice.

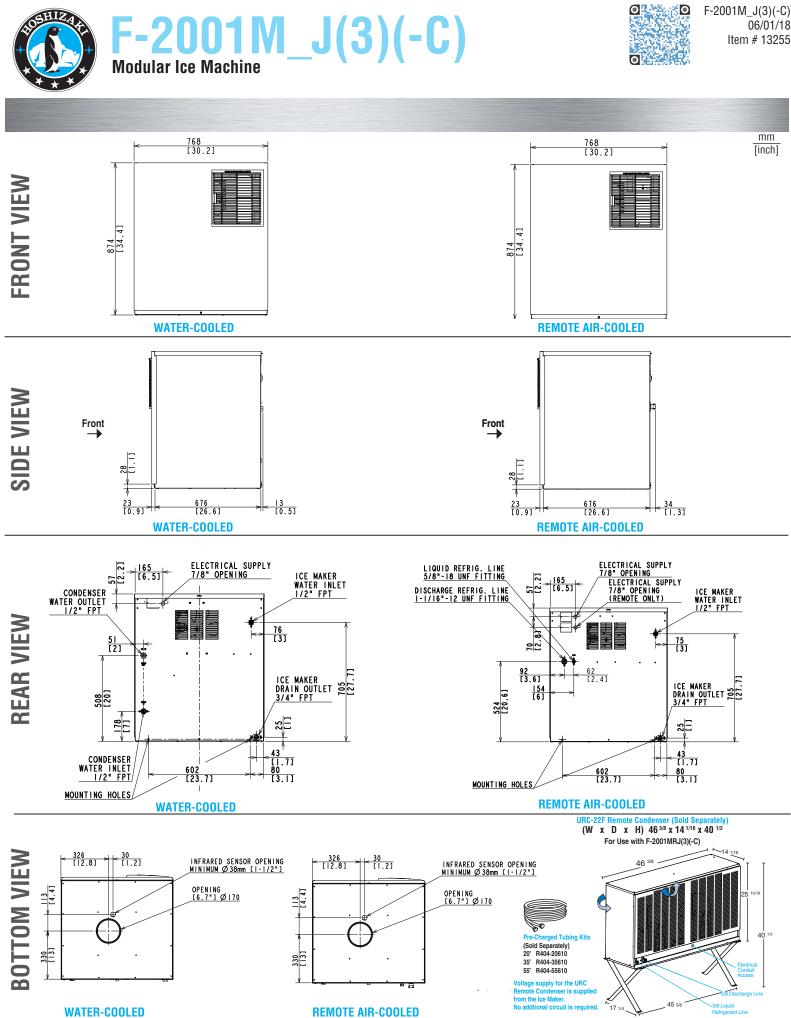

© HOSHIZAKI AMERICA, INC. 618 Hwy, 74 S., Peachtree City, GA 30269 | TEL 800-438-6087 | FAX 800-345-1325 | www.hoshizakiamerica.com

Printed in the U.S.A.